


0	09.02.02	ISSUED		An. T.	Al. T.	A. M.			
Rev.	Date	Description		Drawn	Checked	Approved			
<b>CACCIALANZA &amp; C.</b> s.p.a. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILAND) - ITALY			Client / Project						
			Title						
			JUNCTION BOX FOR REMOTE CONTROLLED MONITOR (2 MOV) WITCH VALVE AND DEFLECTOR STANDARD EXECUTION						
	Date	Name							
Drawn	09.02.02	An. T.							
Checked	09.02.02	Al. T.							
Approved	09.02.02	A. M.							
Code		Sys.	Size	Scale	Dwg nr.	Rev.	Sheet		
			A 3	/	46403030	0	1		
							of	6	
THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY									

SHEET	DESCRIPTION	MODIFY									SHEET	DESCRIPTION	MODIFY								
		A	B	C	D	E	F	G	H	I			A	B	C	D	E	F	G	H	I
1	COVER	0									1										
2	MODIFY TABLE	0									2										
3	TECHNICAL DATA	0									3										
4	WIRE COLOUR TABLE	0									4										
5	TERMINAL CONNECTIONS	0									5										
6	LAY OUT	0									6										
7																					
8																					
9																					
10																					
11																					
12																					
13																					
14																					
15																					
16																					
17																					
18																					
19																					
20																					
21																					
22																					
23																					
24																					
25																					
26																					
27																					
28																					

<b>CACCIALANZA &amp; C. s.p.a</b> ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY	TITLE	CLIENT	DATE	09.02.02	DWG N°	46403030					
	JUNCTION BOX		SCALE	/	PROJECT N°						
	TYPE A3-A4-A6-A8/EL		DRAWN	An.T.							
			0	ISSUED	09.02.02	CHECKED	Al.T.				
			REV.	MODIFY	DATE	APPROVED	A.M.	SHEET N°	2	OF	6


## JUNCTION BOX

RATED SERVICE VOLTAGE:.....400V	TYPE OF SEGREGATION:.....FORM 1	TEMPERATURE:.....40°C
RATED INSULATION VOLTAGE:.....1000V	INSTALLATION:.....OUTDOOR	DEGREE OF PROTECTION:.....IP65
RATED FREQUENCY:.....50Hz	COMPLIANCE WITH STANDARD:.....CEI 17/13.1	COLOR:.....RED RAL3000
ELECTRICAL SYSTEM:.....3Ph+PE	IN/OUT CABLES:.....SIPES	

			DATE	09.02.02		DWG N°	<b>46403030</b>
			SCALE	/			
			DRAWN	An.T.		PROJECT N°	
0	ISSUED	09.02.02	CHECKED	Al.T.			
REV.	MODIFY	DATE	APPROVED	A.M.		SHEET N°	3 OF 4

POWER CIRCUIT		AUXILIARY CIRCUIT	
MIN. SECTION 2,5mmq		MIN. SECTION 1,5mmq	
CONDUCTOR		CONDUCTOR	
PHASES	BLACK	24V - C.A.	RED
NEUTRAL	LIGHT BLUE	110V - A.C	RED
GROUND	YELLOW-GREEN	220V - A.C	BLACK
		24V - D.C	BLUE
WIRE COLOUR TABLE			

CONNECTION TO MONITOR UNIT

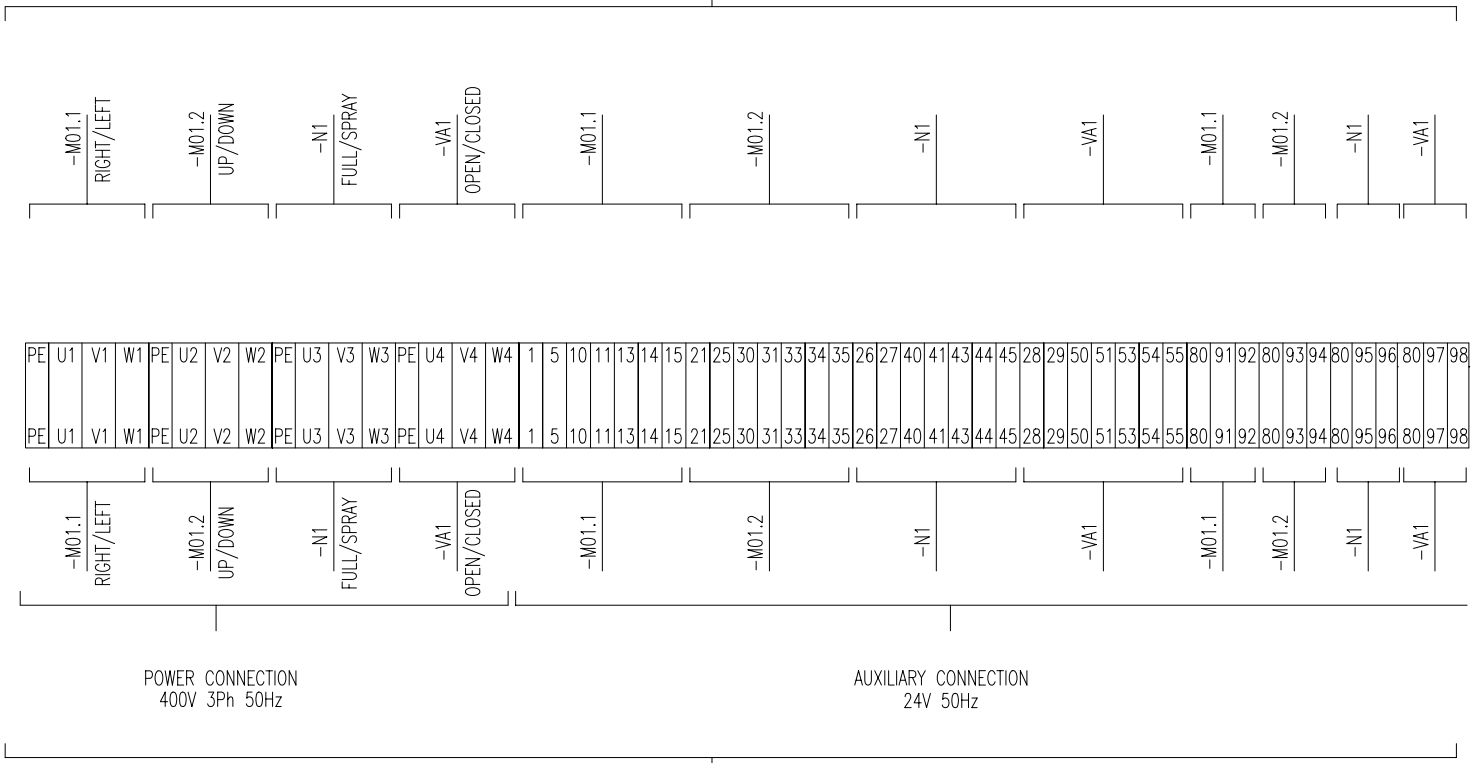

-XJB

PE	U1	V1	W1	PE	U2	V2	W2	PE	U3	V3	W3	PE	U4	V4	W4	1	5	10	11	13	14	15	21	25	30	31	33	34	35	26	27	40	41	43	44	45	28	29	50	51	53	54	55	80	91	92	80	93	94	80	95	96	80	97	98
PE	U1	V1	W1	PE	U2	V2	W2	PE	U3	V3	W3	PE	U4	V4	W4	1	5	10	11	13	14	15	21	25	30	31	33	34	35	26	27	40	41	43	44	45	28	29	50	51	53	54	55	80	91	92	80	93	94	80	95	96	80	97	98

POWER CONNECTION  
400V 3Ph 50Hz

AUXILIARY CONNECTION  
24V 50Hz




CONNECTION TO PANEL

CACCIALANZA & C. s.p.a  
ANTINCENDIO SICUREZZA ANTINQUINAMENTO  
SEGRATE (MILANO) - ITALY

TITLE  
JUNCTION BOX  
TYPE A3-A4-A6-A8/EL

CLIENT

			DATE	09.02.02	DWG N°	46403030
			SCALE	/		
			DRAWN	An.T.		
0	ISSUED	09.02.02	CHECKED	ALT.		PROJECT N°
REV.	MODIFY	DATE	APPROVED	A.M.		SHEET N°. 5 OF 6

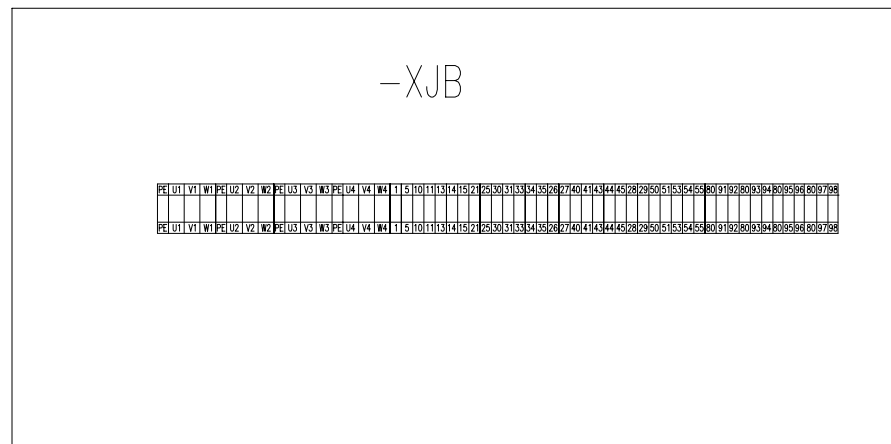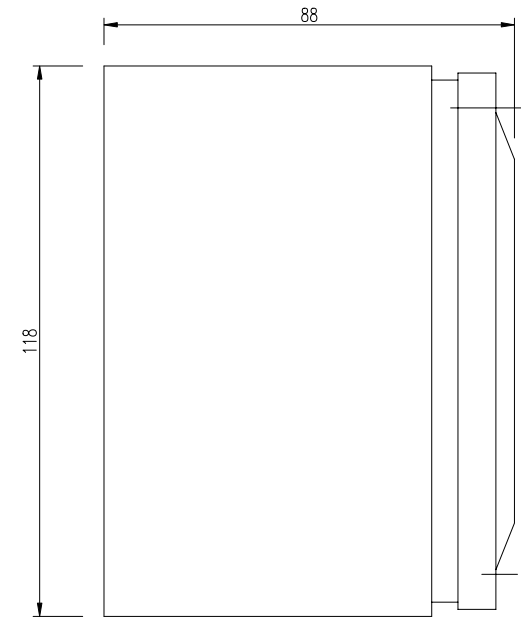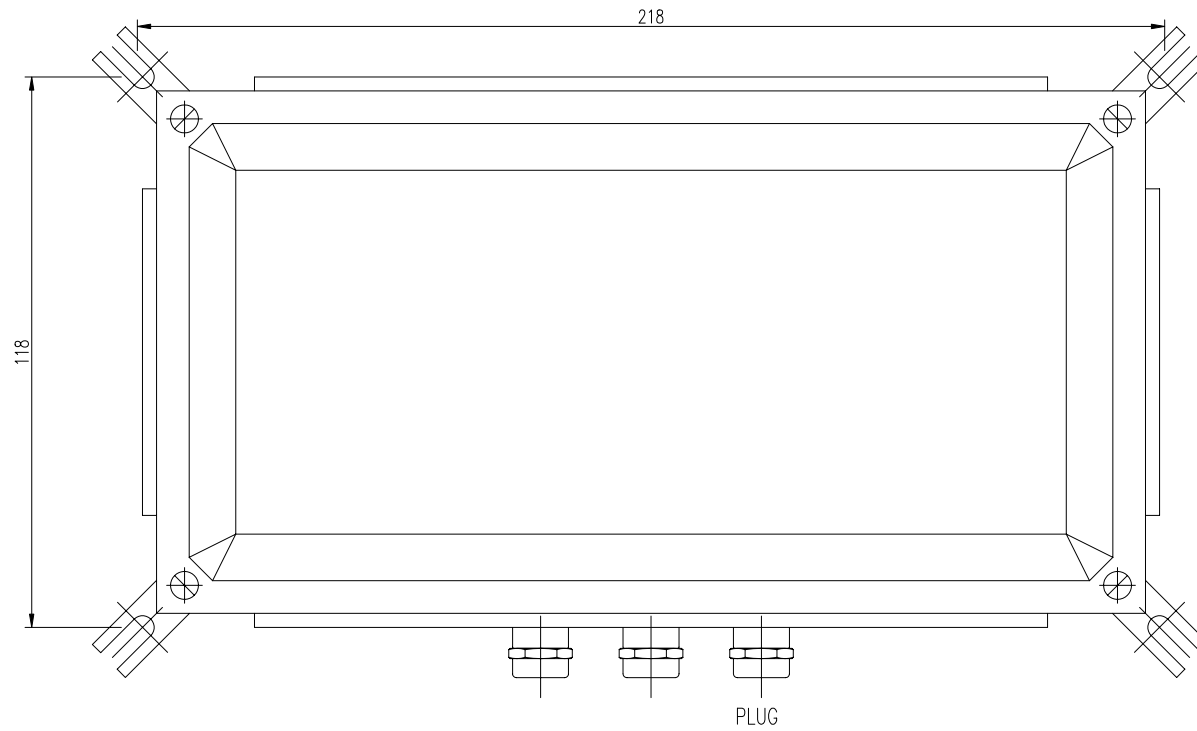

INTERNAL LAY OUT

**CACCIALANZA & C. s.p.a**  
 ANTINCENDIO SICUREZZA ANTINQUINAMENTO  
 SEGRATE (MILANO) - ITALY

TITLE  
**JUNCTION BOX**  
 TYPE **A3-A4-A6-A8/EL**

CLIENT

			DATE	09.02.02	DWG N°	46403030
			SCALE	/	PROJECT N°	
			DRAWN	An.T.		
0	ISSUED	09.02.02	CHECKED	AI.T.		
REV.	MODIFY	DATE	APPROVED	A.M.	SHEET N°	6 OF 6